

# CESI

CESI  
Centro Elettrotecnico  
Sperimentale Italiano  
Giacinto Motta SpA

Via R. Rubattino 54  
20134 Milano - Italia  
Telefono +39 022125.1  
Fax +39 0221255440  
www.cesi.it

Capitale sociale 8 550 000 €  
interamente versato  
Codice fiscale e numero  
iscrizione CCIAA 00793580150

Registro Imprese di Milano  
Sezione Ordinaria  
N. R.E.A. 429222  
P.I. IT00793580150

Schema di certificazione  
**CESI-ATEX**  
**CESI**


Il CESI è stato autorizzato dal governo italiano ad operare quale organismo di certificazione di apparecchi e sistemi destinati a essere utilizzati in atmosfera potenzialmente esplosiva con D.M. 1/3/1983, D.M. 19/6/1990, D.M. 20/7/1998 e D.M. 27/9/2000

1043



# CERTIFICATE

## EC-TYPE EXAMINATION CERTIFICATE

- [1] **EC-TYPE EXAMINATION CERTIFICATE**
- [2] **Equipment or Protective System intended for use in potentially explosive atmospheres Directive 94/9/EC**
- [3] EC-Type Examination Certificate number:  
**CESI 02 ATEX 091**
- [4] Equipment: Terminal boxes series S, S.1, GUA, GUF, EAH.
- [5] Manufacturer: **COR.TEM S.p.A.**
- [6] Address: Via Aquileia 10, Villesse (Gorizia - Italy)
- [7] This equipment or protective system and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to..
- [8] CESI, notified body n. 0722 in accordance with Article 9 of the Council Directive 94/9/EC of 23 March 1994, certifies that this equipment or protective system has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres given in Annex II to the Directive.
- The examination and test results are recorded in confidential report n. EX-A2/030027.
- [9] Compliance with the Essential Health and Safety Requirements has been assured by compliance with:  
**EN 50014: 1997 + A1..A2    EN 50018: 2000    EN 50281-1-1:1999**
- [10] If the sign "X" is placed after the certificate number, it indicates that the equipment or protective system is subject to special conditions for safe use specified in the schedule to this certificate.
- [11] This EC-TYPE EXAMINATION CERTIFICATE relates only to the design, examination and tests of the specified equipment or protective system in accordance to the Directive 94/9/EC. Further requirements of the Directive apply to the manufacturing process and supply of this equipment or protective system. These are not covered by this certificate.
- [12] The marking of the equipment or protective system shall include the following:  
 **II 2 GD EEx d IIC T6 or T5 IP 66/67 T85 °C or T100 °C**

This certificate may only be reproduced in its entirety and without any change, schedule included.

Date September 26<sup>th</sup>, 2002 translation issued on September 26<sup>th</sup>, 2002

Prepared  
Mirko Balaz

Approved  
Ulisse Colombo

**CESI**  
CENTRO ELETTROTECNICO SPERIMENTALE ITALIANO  
Business Unit Certificazione

Il Responsabile

[13]

## Schedule




[14] **EC-TYPE EXAMINATION CERTIFICATE n. CESI 02 ATEX 091**

[15] **Description of equipment**

Terminal boxes series S.1, S, GUA, GUF, EAH.

The enclosures of these terminal boxes are generally made in aluminium alloy. As an alternative they can also be made in brass or in stainless steel (see technical note A4-842 annexed to this certificate).

The various models of the terminal boxes subject of this certificate are identified by a code as follows:

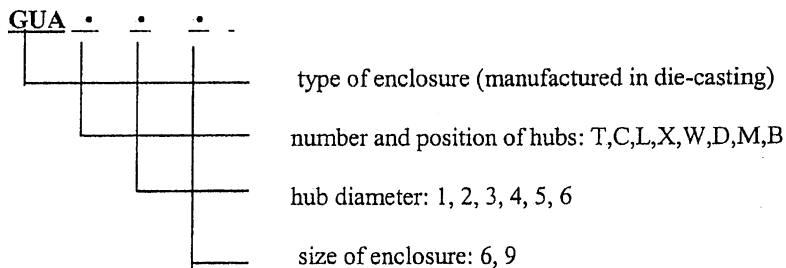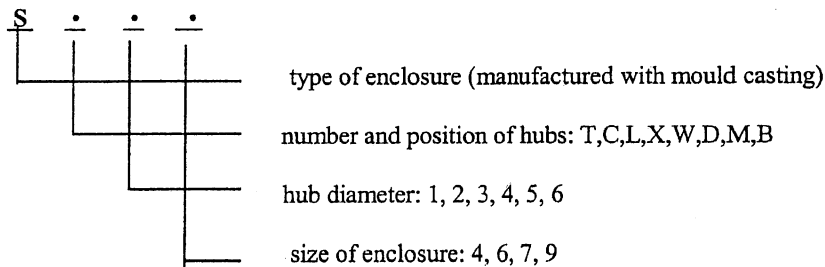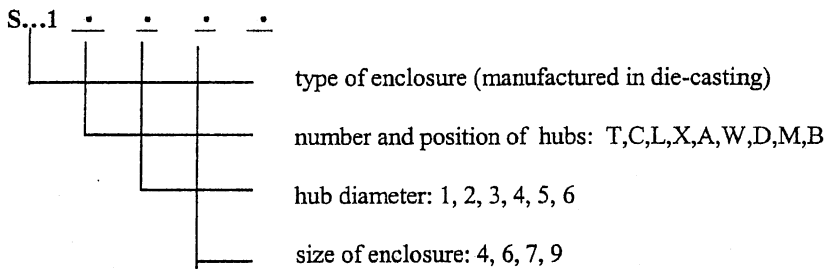


This certificate may only be reproduced in its entirety and without any change, schedule included.

[13]

## Schedule

[14] **EC-TYPE EXAMINATION CERTIFICATE n. CESI 02 ATEX 091**

[15] **Description of equipment (follows)**

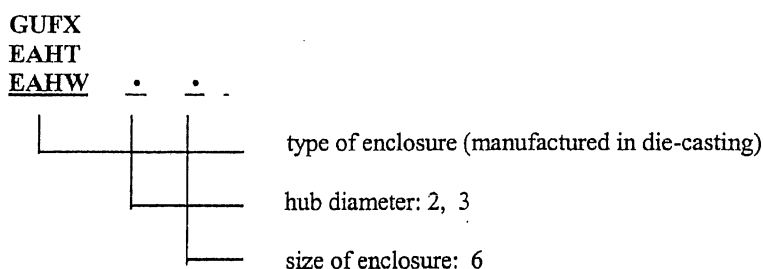

The complete code of all the terminal boxes subject of this certificate is reported in the drawings A1-013, A1-014 and A1-015 annexed to this certificate.

### Electrical characteristics

Rated voltage	750 [V]
Rated frequency	50 ÷ 60 [Hz]

### Terminals

Terminal section	2.5; 4; 6; 10; 16; 25; 35; 70 [mm <sup>2</sup> ]
Rated current	12.5 ÷ 175 [A]
Max. current density	2.5 ÷ 5 [A/mm <sup>2</sup> ]

The type and number of terminals which can be installed in the various enclosures is indicated in detail, together with the maximum admissible currents and current densities, in the drawing A2-191 and in the safety instructions A/17 annexed to this certificate.

Degree of protection IP 66/67 (EN 60529 – 1991)

### Ambient temperature:

- 20 ÷ + 40 °C and - 20 ÷ + 60 °C	for the enclosures of size 4, 6, 7 and 9
- 40 ÷ + 40 °C and - 40 ÷ + 60 °C	for the enclosures of size 4 and 6

### Temperature class for the terminal boxes category 2 G:

T6 for ambient temperature - 20 ÷ + 40 °C and - 40 ÷ + 40 °C
T5 for ambient temperature - 20 ÷ + 60 °C and - 40 ÷ + 60 °C

### Maximum surface temperature of the enclosure for the terminal boxes category 2 D:

T85 °C for ambient temperature - 20 ÷ + 40 °C and - 40 ÷ + 40 °C
T100 °C for ambient temperature - 20 ÷ + 60 °C and - 40 ÷ + 60 °C

The accessories used for cable entry and for closing unused apertures shall be certified according to the standards EN 50014, EN 50018 and EN 50281-1-1 and shall guarantee a degree of protection IP 66/67.

### Warning label

“Use screws of quality A2-70 according UNI 7323 with ultimate tensile strength of at least 700 N/mm<sup>2</sup>”.

### Additional warnings

In case of enclosures of temperature class T5 :  
 “Use cables suitable for a temperature of 90 °C”

This certificate may only be reproduced in its entirety and without any change, schedule included.

[13]

## Schedule

[14] EC-TYPE EXAMINATION CERTIFICATE n. CESI 02 ATEX 091

[16] Report n. EX-A2/030027

### Routine tests

The manufacturer shall carry out the routine tests prescribed at clause 24 of the EN 50014 standard.

The manufacturer is exempted from the routine overpressure test since the terminal boxes have passed the type overpressure test carried out with the static method at 4 times the reference pressure:

- 51.5 bar for enclosures of size 4 and 6 (for operation at - 40°C)
- 35.5 bar for enclosures of size 7 and 9 (for operation at - 20°C)

### Descriptive documents (prot. EX-A2/030028)

- n° A4-842 Rev. 0 (7 p.)	dated	15.02.2002
- n° A3-229 Rev. 0	dated	19.03.2001
- n° A3-230 Rev. 0	dated	15.03.2001
- n° A3-239 Rev. 0	dated	01.10.2001
- n° A2-191 Rev. 0	dated	15.03.2001
- n° A4-801 Rev. 0	dated	01.06.2000
- n° A1-013 Rev. 0	dated	20.03.2001
- n° A1-014 Rev. 0	dated	20.03.2001
- n° A1-015 Rev. 0	dated	20.03.2001
- Technical data of resin EPDM 70 black	dated	29.11.2001
- Technical data of resin NBR 70 black	dated	03.11.2000
- Technical data of resin Silicon 70 red	dated	04.02.2002
- Technical data of resin FKM (VITON) 70 black	dated	29.11.2001
- Safety instructions Annexe A/17 Rev. 0 (6 p.)	dated	01.06.2000
- EC declaration of conformity n° CE/0031	dated	19.03.2001

One copy of all documents is kept in CESI files.

[17] Special conditions for safe use

None.

[18] Essential Health and Safety Requirements

Covered by standards.

## EXTENSION n. 01/07



to EC-Type Examination Certificate CESI 02ATEX091

Equipment: Terminal boxes series: S, S.1, GUA, GUF, EAH

Manufacturer: **COR.TEM S.p.A.**

Address: Via Aquileia 10, Villesse (Gorizia - Italy)

### Admitted variation

- Update to EN 60079-0 (2006), EN 60079-1 (2004), EN 60079-7 (2003), EN 60079-11 (2007)  
EN 61241-0 (2006), EN 61241-1 (2004) Standards
- Update of nameplate
- Constructional modification, new material ( cast iron )
- Use of terminal block with 1,5 mm<sup>2</sup> section
- New execution "Ex e", "Ex i" and "Ex d [ia]"
- New max. ambient temperatures (+65°C, +80°C and +150°C, see table 1)

### Equipments identification and description

According to the protection mode, the terminal boxes S, S.1, GUA, GUF EAH shall include the following markings:

	II 2GD	Ex d IIC T6, T5, T3 ; Ex tD A21 IP66/67 T 85 °C, T 100 °C, T200°C
	II 2GD	Ex e II T6, T5, T4 ; Ex tD A21 IP66/67 T 85 °C, T 100 °C ; T135°C
	II 2 or 1 GD	Ex i. IIC T6, T5, T4 ; Ex tD A21 IP66/67 T 85 °C, T 100 °C, T135°C
	II 2 (1 or 2) GD	Ex d[i.] IIC T6, T5 ; Ex tD [i.D] A21 IP66/67 T 85 °C, T 100 °C

This extension and annexed descriptive documents must be annexed to the EC-Type Examination Certificate CESI 02ATEX091.

This document may only be reproduced in its entirety and without any change.

date 19/12/2007 - translation issued the 19/12/2007

prepared Pierluigi Molinari

verified Mirko Balaz

approved Fiorenzo Bregani

**CESI S.p.A.**  
Divisione Energia  
"Area Tecnica Certificazione"  
Il Responsabile

page 1/3

## EXTENSION n. 01/07

to EC-Type Examination Certificate CESI 02ATEX 091

### Equipments identification and description (follows)

#### Electrical characteristics

Rated voltage 750 [V]  
 Rated frequency 50 ÷ 60 [Hz]

#### Terminals

Terminal section 1,5; 2,5; 4; 6; 10; 16; 25; 35; 70 [mm<sup>2</sup>]  
 Rated current 10.0 ÷ 175 [A]  
 Max. current density 2.5 ÷ 6,6 [A/mm<sup>2</sup>]

The type and number of terminals which can be installed in the various enclosures is indicated in detail, together with the maximum admissible currents and current densities, in the drawings A2-191; A2-209; A2-210 and in the safety instructions F-274 annexed to this certificate.

The electrical characteristics of junction boxes in the version Ex-i depends on the characteristics of the intrinsic safety circuits and of the associated apparatus used.

Degree of protection IP 66/67 (EN 60529 – 1991)

The standard ambient temperature range:

- 20 ÷ + 40 °C for the enclosures of size 4, 6, 7 and 9

- 40 ÷ + 40 °C for the enclosures of size 4 and 6

The boxes can also be installed with other range of ambient temperatures . In this case shall be used terminals made in material as indicated on following tables 1 and 2.

TABLE 1

Junction boxes execution Ex d IIC			
Ambient temperature	Terminals Material	Temperature class	Maximum surface temperature
-20°C +40°C -40°C +40°C (*)	Poliammide (PA) or upper	T6	T85°C
-20°C +65°C -40°C +65°C (*)	Melamine (KrG) Wemind Stamin (KrS)	T5	T100°C
-20°C +150°C -40°C +150°C (*)	Ceramic (Steatite)	T3	T200°C

TABLE 2

Junction boxes execution Ex e II or Ex i IIC (terminals ATEX certified)			
Ambient temperature	Terminals Material	Temperature class	Maximum surface temperature
-20°C +40°C -40°C +40°C (*)	Poliammide (PA) or upper	T6	T85°C
-20°C +65°C -40°C +65°C (*)	Melamine (KrG) Wemind Stamin (KrS)	T5	T100°C
-20°C +80°C -40°C +80°C (*)	Melamine (KrG) Stamin (KrS) Ceramic (Steatite)	T4	T135°C

(\*) – valid only for junction boxes size 4 and 6

This document may only be reproduced in its entirety and without any change..

## EXTENSION n. 01/07

to EC-Type Examination Certificate CESI 02ATEX 091

### Cable entries

The accessory used for cable entries and for closing unused aperture shall be certified according to the following Standards:

- terminal boxes in execution "Ex d" : EN 60079-0, EN 60079-1, EN 61241-0, EN 61241-1
- terminal boxes in execution "Ex e" : EN 60079-0, EN 60079-7, EN 61241-0, EN 61241-1
- terminal boxes in execution "Ex i" : EN 60079-0, EN 61241-0, EN 61241-1

and shall guarantee a degree of protection IP 66/67.

### **Warning label**

For the enclosures with temperature class T5, T4 and T3 when the temperature under rated condition is higher than 70°C at the cable entry point or 80°C at the branching point of the conductors: - suitable heat resisting cables shall be used.

**Report n. EX-A7035517**

### **Routine tests**

The manufacturer shall carry out the routine tests prescribed at par. 27 of the EN 60079-0 and at par. 24 of the EN 61241-0 Standards.

The manufacturer is exempted from the routine overpressure test since the terminal boxes have passed the type overpressure test carried out with the static method at 4 times the reference pressure:

- 51.5 bar for enclosures of size 4 and 6 (for operation at - 40°C)
- 35.5 bar for enclosures of size 7 and 9 (for operation at - 20°C)

The dielectric test on terminal box "Ex e" assembled by manufacturer, shall be performed according to the par. 7.2 of the EN 60079-7 Standard.

### **Descriptive documents (prot. EX-A7035520)**

- Technical Note A4-4982 (3 pg.)	Rev. 0	dated	03/04/2007
- Drawing n° A2-191	Rev. 2	dated	03/04/2007
- Drawing n° A2-209	Rev. 0	dated	03/04/2007
- Drawing n° A2-210	Rev. 0	dated	03/04/2007
- Drawing n° A3-239	Rev. 2	dated	03/04/2007
- Drawing n°. A4-998	Rev. 0	dated	03/04/2007
- Drawing n°. A4-999	Rev. 0	dated	03/04/2007
- Drawing n°. A4-1010	Rev. 0	dated	03/04/2007
- Document n°. A4-4951	Rev. 0	dated	02/04/2007
- Document n°. A4-4952	Rev. 0	dated	02/04/2007
- EC Declaration of Conformity n° 0031		dated	03/04/2007
- Safety Instruction F-274 (12 pg.)	Rev. 1	dated	03/04/2007

One copy of all documents is kept in CESI files.

### **Essential Health and Safety Requirements**

The Health and Safety Requirements are assured by compliance with the following Standards:

- EN 60079-0 : 2006: Electrical apparatus for explosive gas atmospheres.  
General requirements
- EN 60079-1 : 2004 Flamoproof enclosures "d".
- EN 60079-7: 2003 Increased safety "e"
- EN 60079-11: 2007 Intrinsic safety "i"
- EN 61241-0 : 2006 Electrical apparatus for use in the presence of combustible dust.  
General requirements
- EN 61241-1 : 2004 Protection by enclosures "tD"

This document may only be reproduced in its entirety and without any change..









**EXTENSION n. 02/14**

to EC-Type Examination Certificate CESI 02 ATEX 091

***Descriptive documents (prot. EX- B4005480)***

- Technical note A4-5672 (pagg. 8)	rev.0	dated	10.09.2012;
- Safety, maintenance and mounting instructions F-274 (pagg. 11)	rev.2	dated	10.09.2012;
- Declaration of Conformity n° 0031	---	dated	10.09.2012
- Drawing n° A2-191	rev.3	dated	10.09.2012
- Drawing n° A2-209	rev.1	dated	10.09.2012
- Drawing n° A2-210	rev.1	dated	10.09.2012
- Drawing n° A3-239	rev.3	dated	10.09.2012
- Drawing n° A4-998	rev.1	dated	10.09.2012
- Drawing n° A4-999	rev.1	dated	10.09.2012

One copy of all documents is kept in CESI files.

***Essential Health and Safety Requirements***

The Essential Health and Safety Requirements are assured by compliance to the following standards:

- EN 60079-0: 2012 Explosive atmospheres – Part 0: Equipment - General requirements;
- EN 60079-1: 2007 Explosive atmospheres – Part 1: Equipment protection by flameproof enclosure “d”;
- EN 60079-7: 2007 Explosive atmospheres – Parte 1: Equipment protection by increased safety “e”;
- EN 60079-11: 2012 Explosive atmospheres – Parte 1: Equipment protection by intrinsic safety “i”;
- EN 60079-31: 2009 Explosive atmospheres – Part 31: Equipment dust ignition protection by enclosure “t”.